



### TEST REPORT

DATE: 03-23-2023

Page 1 of 1

TEST NUMBER: 0295657

<b>CLIENT</b>	Lions Floor
---------------	-------------

<b>TEST METHOD CONDUCTED</b>	ASTM F387 Standard Test Method for Measuring Thickness of Resilient Floor Covering with Foam Layer
------------------------------	--




DESCRIPTION OF TEST SAMPLE	
<b>IDENTIFICATION</b>	Indoor Delight Collection
<b>COLOR</b>	Country Breeze
<b>ROLL NUMBER</b>	SKU: LI-ID01V1134P221210
<b>CONSTRUCTION</b>	SPC

#### GENERAL PRINCIPLE

The total thickness of a resilient flooring material is determined through measurements made using a .250 inch presser foot and a dial micrometer. The average of 5 total measurements is reported as the average total thickness.

#### TEST RESULTS

		THICKNESS
	SPECIMEN 1	0.265 Inch
	SPECIMEN 2	0.263 Inch
	SPECIMEN 3	0.264 Inch
	SPECIMEN 4	0.263 Inch
	SPECIMEN 5	0.263 Inch
<b>AVERAGE TOTAL THICKNESS</b>		0.264 Inch

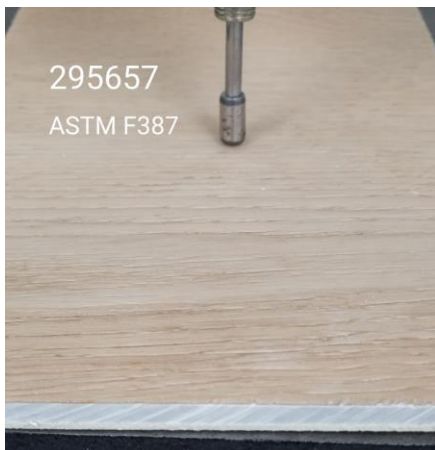

APPROVED BY: *Gary Osbourn*



This facility is accredited by the National Voluntary Laboratory Accreditation Program for the specific scope of accreditation under Lab Code 100297. This accreditation does not constitute an endorsement, certification, or approval by NIST or any agency of the United States Government for the product tested. This report is provided for the exclusive use of the client to whom it is addressed. It may be used in its entirety to gain product acceptance from duly constituted authorities. This report applies only to those samples tested and is not necessarily indicative of apparently identical or similar products. This report, or the name of Professional Testing Laboratory, Inc. shall not be used under any circumstance in advertising to the general public.

